


# STATE OF COLORADO

## Examining Board of Plumbers

(Below is a sample of a 2 story, 2 bathroom home)

# HOMEOWNER INSTRUCTIONS

For minimum plumbing standards, refer to 1994 Uniform Plumbing Code Book

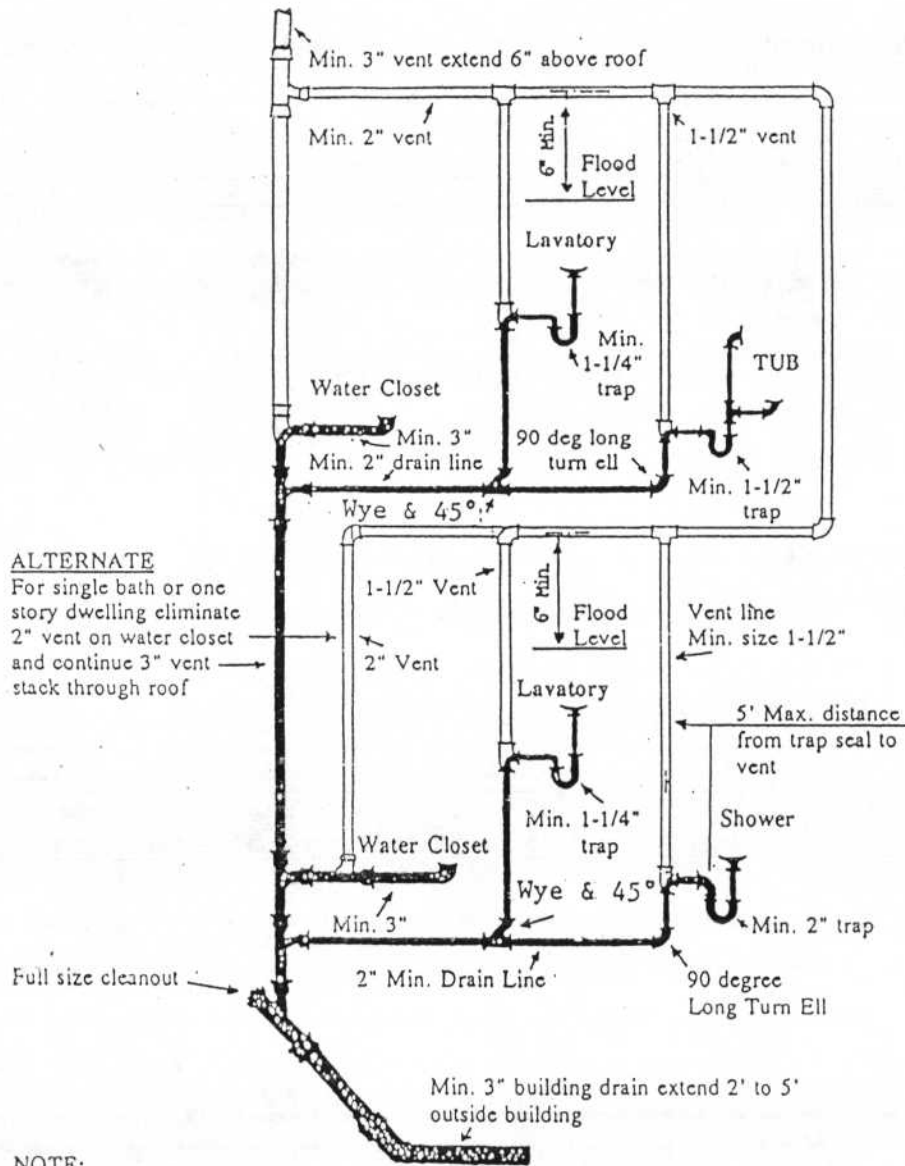


### ALTERNATE

For single bath or one story dwelling eliminate 2" vent on water closet and continue 3" vent stack through roof

### NOTE:

- Material ABS or PVC schedule 40 - no mixing of ABS or PVC (Black & White)
- Min. fall 1/4" per foot
- Min. horizontal strapping every 4'
- Use approved drainage fitting where required

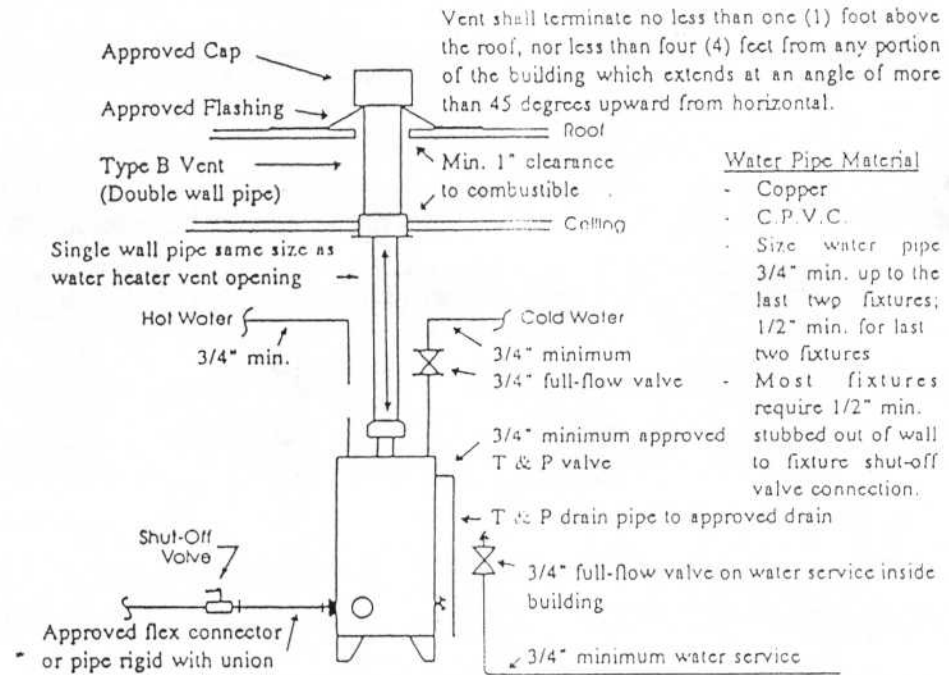

### Water Pipe Material

- Copper
- C.P.V.C.
- Size water pipe 3/4" min. up to the last two fixtures; 1/2" min. for last two fixtures
- Most fixtures require 1/2" min. stubbed out of wall to fixture shut-off valve connection.

### GAS FIRED WATER HEATER WITH GRAVITY VENT

